

PS20_GEN TO GEN_12_10_2025_V00_R00.DWG

SAVANT POWER STORAGE 20

PS20-12.5KW-100A-XX

GENERAL NOTES

1. CONCEPT ONLY: NOT FOR CONSTRUCTION OR PERMIT SUBMITTAL.
2. AS A BASIS FOR THE MINIMUM INSTALLATION CRITERIA, ENGINEER OF RECORD (EOR) IS TO ENSURE THAT ALL WORK MUST BE PERFORMED IN ACCORDANCE WITH THE LATEST EDITIONS OF THE STATE BUILDING CODE, STATE ELECTRICAL CODE, NFPA, ANSI/NECA INSTALLATION STANDARDS AND OTHER APPLICABLE CODES, REGULATIONS AND LAWS OF LOCAL, STATE AND FEDERAL GOVERNMENT, OTHER AUTHORITIES HAVING JURISDICTION AND APPLICABLE BASE BUILDING STANDARDS AND SPECIFICATIONS.
3. THESE DRAWINGS ILLUSTRATE A CONCEPT SHOWING MAJOR EQUIPMENT AND INTERCONNECTIONS BUT ARE NOT TO BE CONSIDERED FABRICATION / SITE SPECIFIC DRAWINGS. CABLE SIZING, SHORT CIRCUIT, GROUNDING, OVERCURRENT PROTECTION AND DISCONNECTING MEANS TO BE DESIGNED BY EOR WITH PE STAMPED SITE SPECIFIC CONTRACT DRAWINGS.
4. EOR TO ENSURE FINAL SYSTEM DESIGN ADHERES TO ALL APPLICABLE ARTICLES OF NEC INCLUDING ARTICLES 110, 240, 250, 310, 480, 690, 702, 705, 706 AND 750.
5. EOR SHALL REVIEW AND PROVIDE CALCULATIONS FOR ALL DOWNSTREAM LOADS FED BY THE PS20 INVERTER. ENSURE THAT THE COMBINATION OF ALL CONTINUOUS BASE LOAD & INRUSH SURGES CAUSED BY LINEAR AND NON-LINEAR LOADS ARE BELOW THE OVERLOAD SET POINT LIMITS OF THE INVERTER. CURRENT MAGNITUDE AND DURATION SHALL BE FACTORED INTO THE OVERALL DESIGN OF THE SYSTEM TO AVOID ANY NUISANCE TRIPPING. MITIGATION TECHNIQUES SUCH AS THE ADDITION OF SOFT-STARTS ON INDUCTIVE LOADS; RELOCATION OF LOADS TO NON-BACKED UP PANELS; OR GENERAL SYSTEM UPSIZING SHALL BE CONSIDERED.
6. EOR SHALL REVIEW AND PROVIDE CALCULATIONS FOR ALL DOWNSTREAM LOADS FED BY A GENERATOR WHEN CONNECTING TO THE PS20 SYSTEM IN AN OFF-GRID SITUATION. SIZE THE GENERATOR ACCORDING TO THE LATEST "SAVANT POWER STORAGE GENERATOR INSTALLATION AND ATS INTEGRATION GUIDE" FOUND IN THE "SAVANT POWER RESOURCE LINK" ON THIS SHEET.
7. FOR ALL PARALLEL INSTALLS, WHEN INSTALLING AC WIRE BETWEEN THE UPSTREAM BREAKERS IN THE GRID COMBINER PANEL (GCP) TO THEIR RESPECTIVE INVERTER GRID TERMINAL ON THE PS20, IT IS REQUIRED THAT THE WIRE LENGTH TO THE CLOSEST PS20 IS AT LEAST 65% THE WIRE LENGTH OF THE FURTHEST INSTALLED PS20 FROM THE GCP. THIS HELPS ENSURE THAT THE WIRE RESISTANCE DIFFERENCE IS KEPT TO A MINIMUM BETWEEN THE FURTHEST AND CLOSEST PS20. THE SAME IS REQUIRED FOR GENERATOR / AC COUPLED SOLAR APPLICATIONS USING A GENERATOR COMBINER PANEL FEEDING THE GEN TERMINALS ON PARALLEL PS20 UNITS.
8. DC SOLAR SHALL BE SUPPORTED IN UNLIMITED SOLAR SELL BACK; LIMITED SOLAR SELL BACK; AND NO SOLAR SELL BACK INTERCONNECTION AGREEMENTS.
9. AC SOLAR SHALL ONLY BE SUPPORTED IN UNLIMITED SOLAR SELL BACK INTERCONNECTION AGREEMENTS. IN OFF GRID SITUATIONS, FREQUENCY SHIFTING IS USED TO SHUT OFF AC SOLAR AT THE PS20 INVERTER GEN TERMINAL.
10. REFER TO POWER STORAGE 20 SPECIFICATIONS FOR ADDITIONAL INFORMATION.
11. REFER TO THE SAVANT POWER STORAGE 20 INSTALLATION GUIDE FOR ADDITIONAL INFORMATION SUCH AS MAINTENANCE SPACE REQUIREMENTS TO AID IN THE DESIGN OF YOUR PROJECT.

SAVANT POWER RESOURCE LINK


PLEASE USE THIS QR CODE TO GET TO ALL THE LATEST SPECIFICATION SHEETS, INSTALLATION GUIDES FOR THE SAVANT POWER SYSTEM.



	INTER-DISCIPLINE REVIEW															DSGN					SAVANT POWER	JOB NUMBER	REV
	DISC	ARCH	CIVIL	ELECT	I&C	MECH	STRUCT									DRN	MAW	12-10-2025				-	00
	DATE	*	*	*	*	*	*									CKD	JP					DRAWING NUMBER	009-2602-00
	INIT	*	*	*	*	*	*	00	VERSION 00	12-10-2025	MAW					SCALE: AS NOTED							
	REV	REVISIONS								DATE	DRN	DSGN	CKD	APPD									
	PS20 GENERAL NOTES GENERATOR TO GEN TERMINAL DESIGN																						

PS20_GEN TO GEN_12_10_2025_V00_R00.DWG

LEGEND & ABBREVIATIONS		KEYNOTE DRAWING NOTES	
(PBS)	PROVIDED BY SAVANT POWER, INSTALLED BY OTHERS		CONSIDER USING A POLARIS TAP WITHIN THE ATS/MTS TO TAP THE INCOMING FEED. IF NO SPACE WITHIN THE ATS/MTS IS AVAILABLE, AN EXTERNAL JUNCTION BOX MAY BE USED.
(EBO)	EQUIPMENT FURNISHED AND INSTALLED BY OTHERS		
(XM)	EQUIPMENT EXISTING TO REMAIN		
SPD	SURGE PROTECTION DEVICE		
TYP	TYPICAL THROUGHOUT DRAWING		
AF	SWITCH DISCONNECT FUSE RATING		

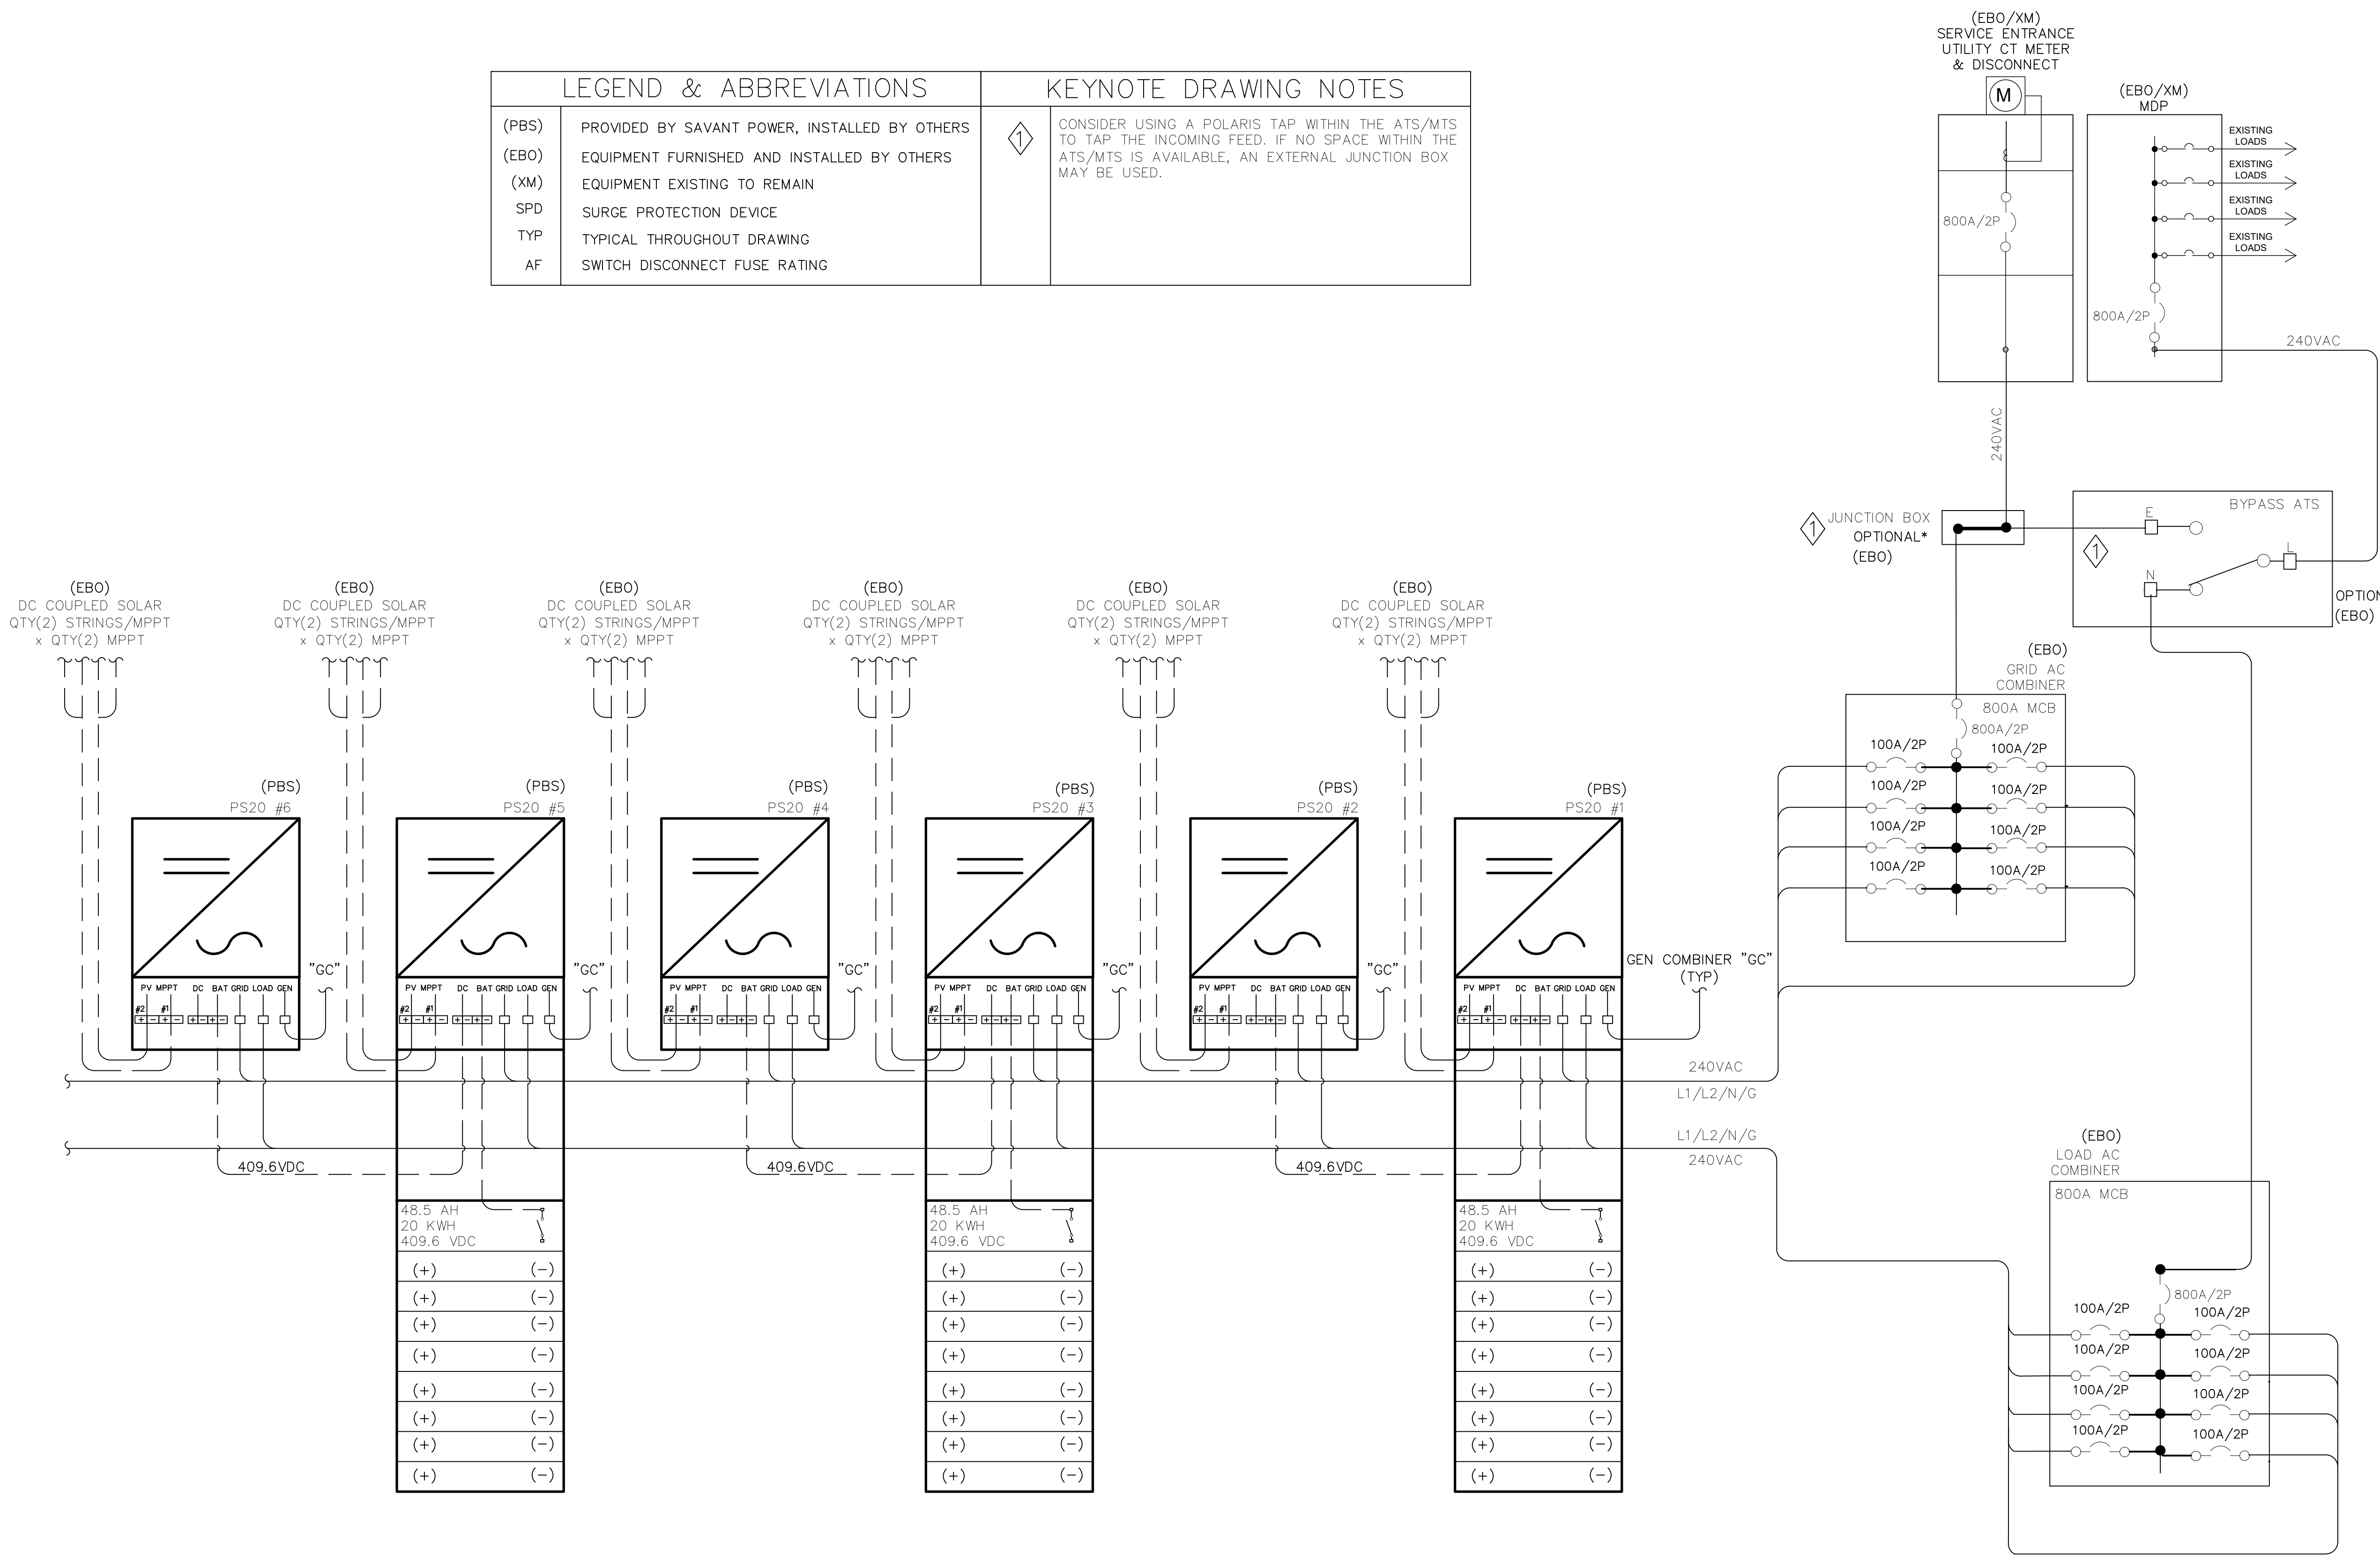

800A POWER STORAGE 20 SYSTEM NOTES



- 80KWH RATED ENERGY STORAGE
- OFFGRID CONTINUOUS: 50KW / 208.3A
- QTY (16) 8.5KW / 26A RATED PEAK DC COUPLED PV MPPT CHANNELS. 6.25KW MAX PV/MPPT POWER PER CHANNEL.
- QTY (8) 24KW GEN INPUTS OR UP TO (8) 6.25KW AC COUPLED PV INPUTS
- MAXIMUM AC+DC COUPLED SOLAR COMBINATION: 12.5KW / BATTERY STACK
- 192KW / 800A GRID PASS THROUGH
- CHARGE RATE: 3.25KW / INVERTER
- DISCHARGE RATE: 6.5KW / BATTERY STACK
- 6.25KW / INVERTER
- 12.5KW / BATTERY STACK

INTER-DISCIPLINE REVIEW																DSGN					SAVANT POWER	JOB NUMBER	REV						
DISC	ARCH	CIVIL	ELECT	I&C	MECH	STRUCT										DRN	MAW	12-10-2025				-	△ 00						
DATE	*	*	*	*	*	*										CKD	JP												
INIT	*	*	*	*	*	*	00	VERSION 00			12-10-2025	MAW				SCALE: AS NOTED													
REV	REVISIONS								DATE	DRN	DSGN	CKD	APPD																
																					CERTIFICATE OF REGISTRATION NO. X-0000			800A: 50KW - 80KWH ESS PS20 ONLINE DIAGRAM (120/240V)			DRAWING NUMBER 009-2561-00		

CERTIFICATE OF REGISTRATION NO. X-0000

PS20_GEN TO GEN_12_10_2025_V00_R00.DWG

GEN TERMINAL SOURCE OPTIONS

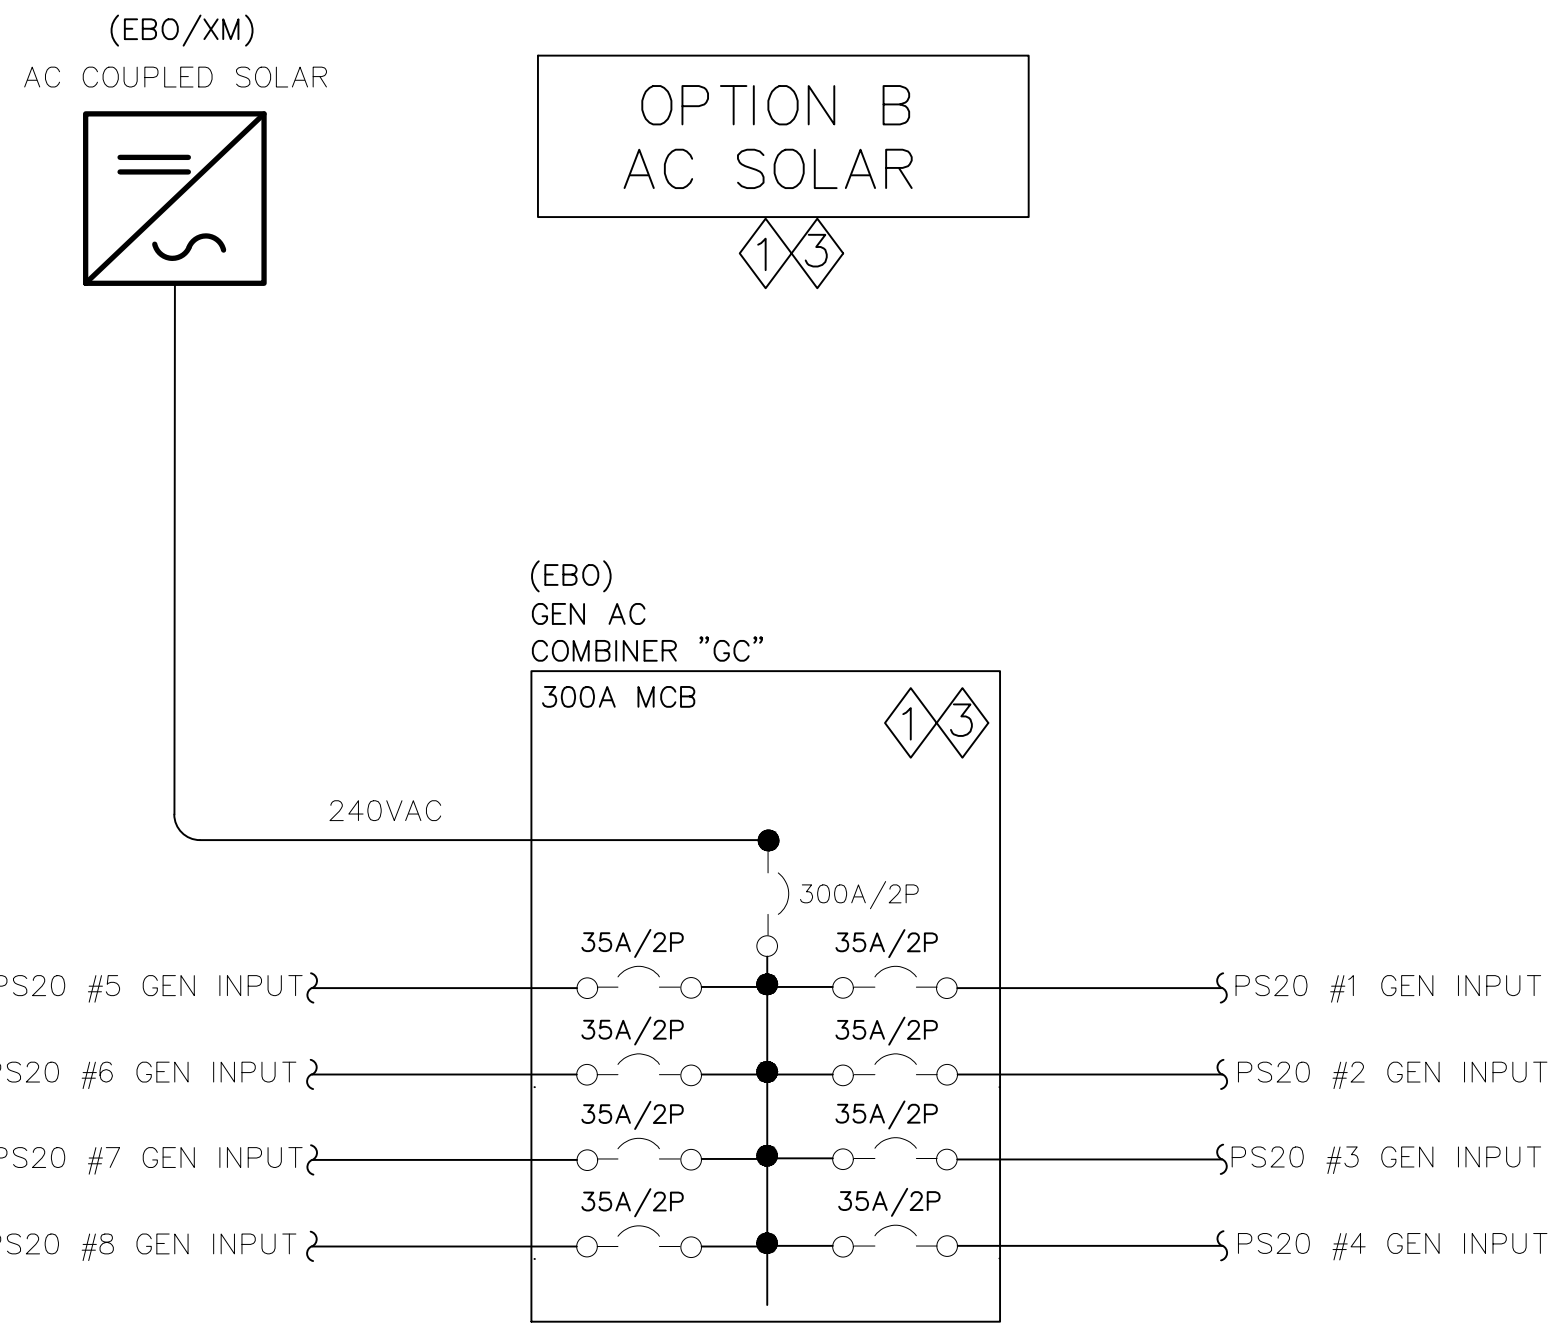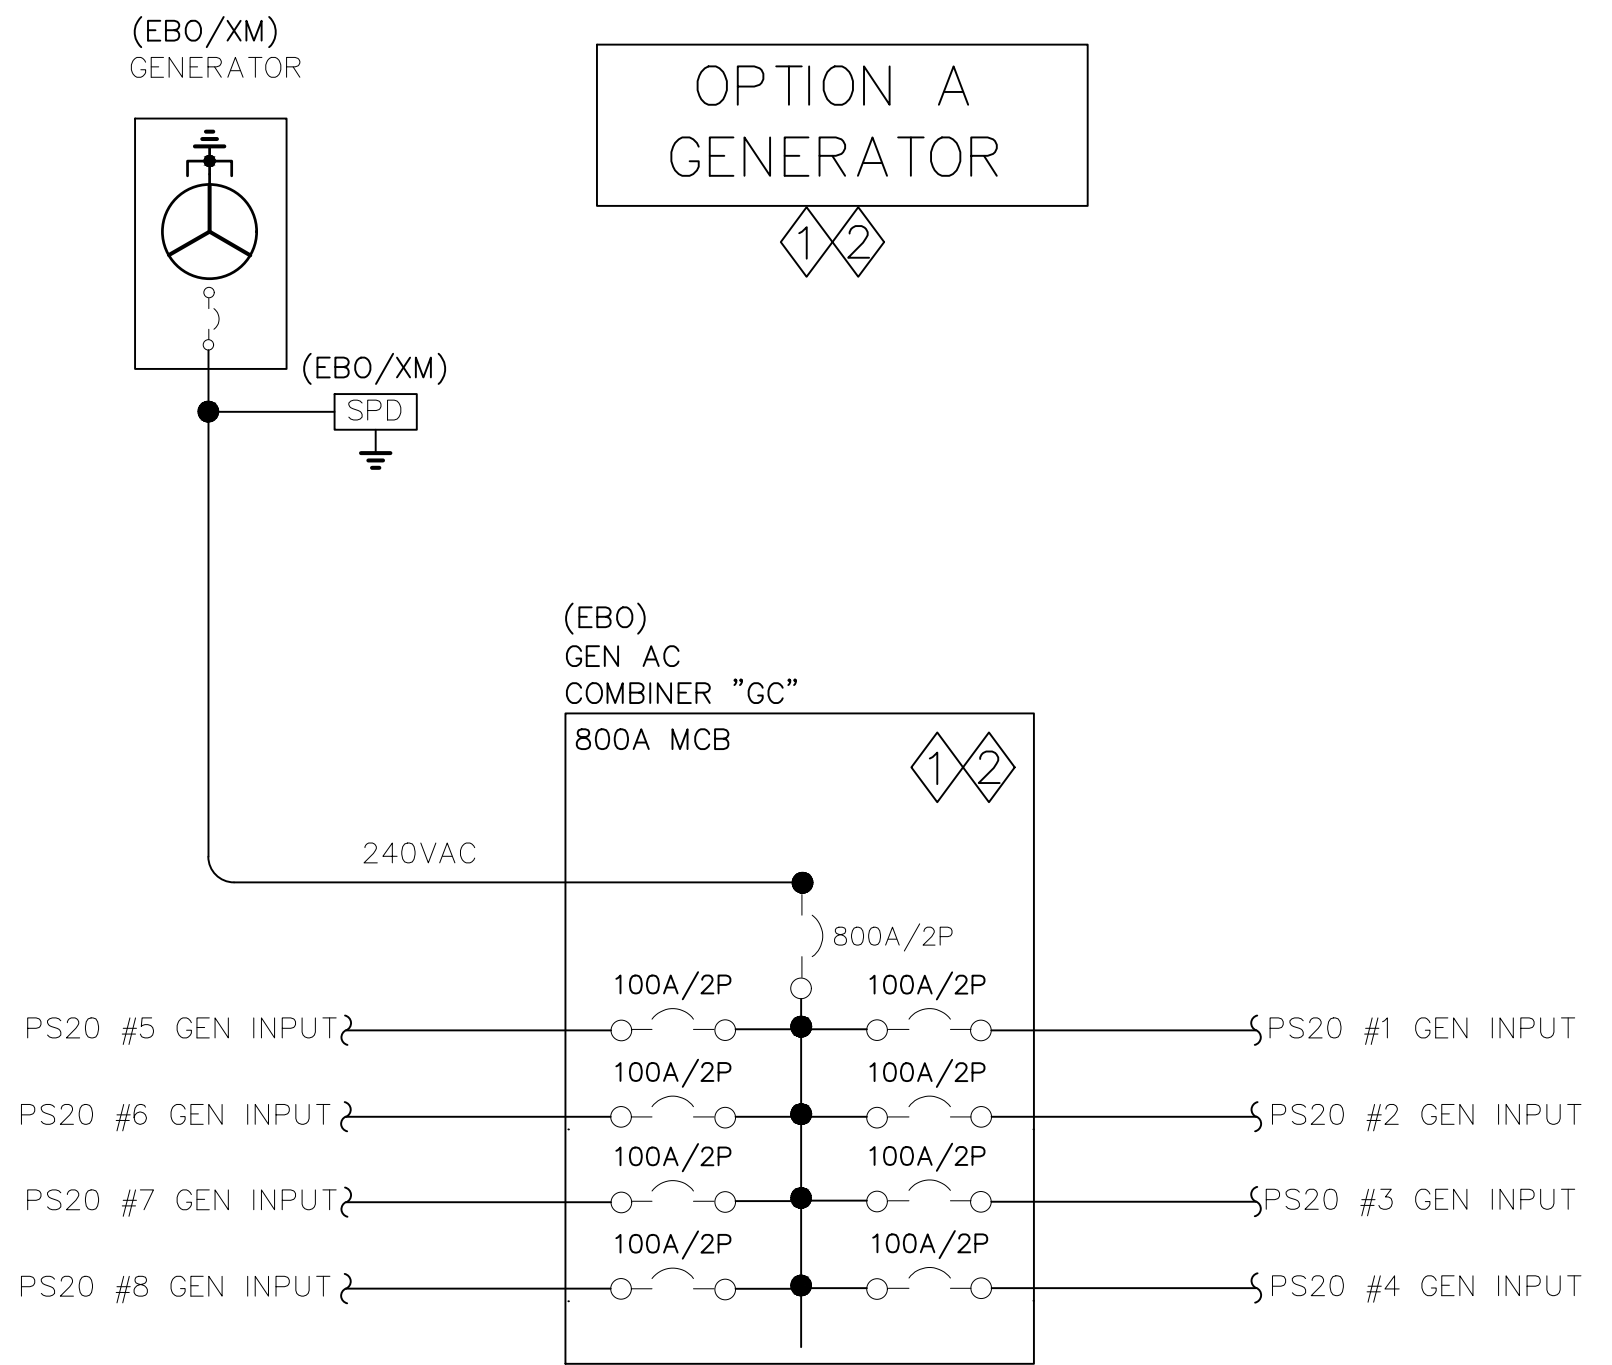

LEGEND & ABBREVIATIONS


(PBS)	PROVIDED BY SAVANT POWER, INSTALLED BY OTHERS
(EBO)	EQUIPMENT FURNISHED AND INSTALLED BY OTHERS
(XM)	EQUIPMENT EXISTING TO REMAIN
SPD	SURGE PROTECTION DEVICE
TYP	TYPICAL THROUGHOUT DRAWING
AF	SWITCH DISCONNECT FUSE RATING

KEYNOTE DRAWING NOTES

◇	OCPD SIZING ON THIS CONCEPT DRAWING SHOWS THE MAXIMUM ALLOWABLE SIZE FOR THIS PS20 CONFIGURATION. ENGINEER OF RECORD TO SIZE OCPD AND CABLE SIZES ACCORDING TO SITE CONDITIONS AND LATEST NEC CODE. SEE GENERAL NOTES SHEET FOR ADDITIONAL DESIGN GUIDANCE.
◇	QTY (1) PS20 GEN TERMINAL INPUT IS RATED UP TO 24KW PER INVERTER FOR GENERATOR PASS-THROUGH. GENERATOR POWER SHALL NOT BE LESS THAN THE POWER OF THE POTENTIAL HOUSE LOAD, PLUS THE SUM OF THE CHARGING POWER FOR ALL BATTERY STACKS.
◇	QTY (1) PS20 GEN TERMINAL INPUT IS RATED UP TO 12.5KW AC SOLAR PER BATTERY STACK. OFF GRID FREQUENCY SHIFTING IS AN INCLUDED FUNCTION ON THE GEN TERMINAL TO TURN AC SOLAR FEEDS ON OR OFF.

800A POWER STORAGE 20 SYSTEM NOTES

- 80KWH RATED ENERGY STORAGE
- OFFGRID CONTINUOUS: 50KW / 208.3A
- QTY (16) 8.5KW / 26A RATED PEAK DC COUPLED PV MPPT CHANNELS. 6.25KW MAX PV/MPPT POWER PER CHANNEL.
- QTY (8) 24KW GEN INPUTS OR UP TO (8) 6.25KW AC COUPLED PV INPUTS
- MAXIMUM AC+DC COUPLED SOLAR COMBINATION: 12.5KW / BATTERY STACK
- 192KW / 800A GRID PASS THROUGH
- CHARGE RATE: 3.25KW / INVERTER 6.5KW / BATTERY STACK
- DISCHARGE RATE: 6.25KW / INVERTER 12.5KW / BATTERY STACK

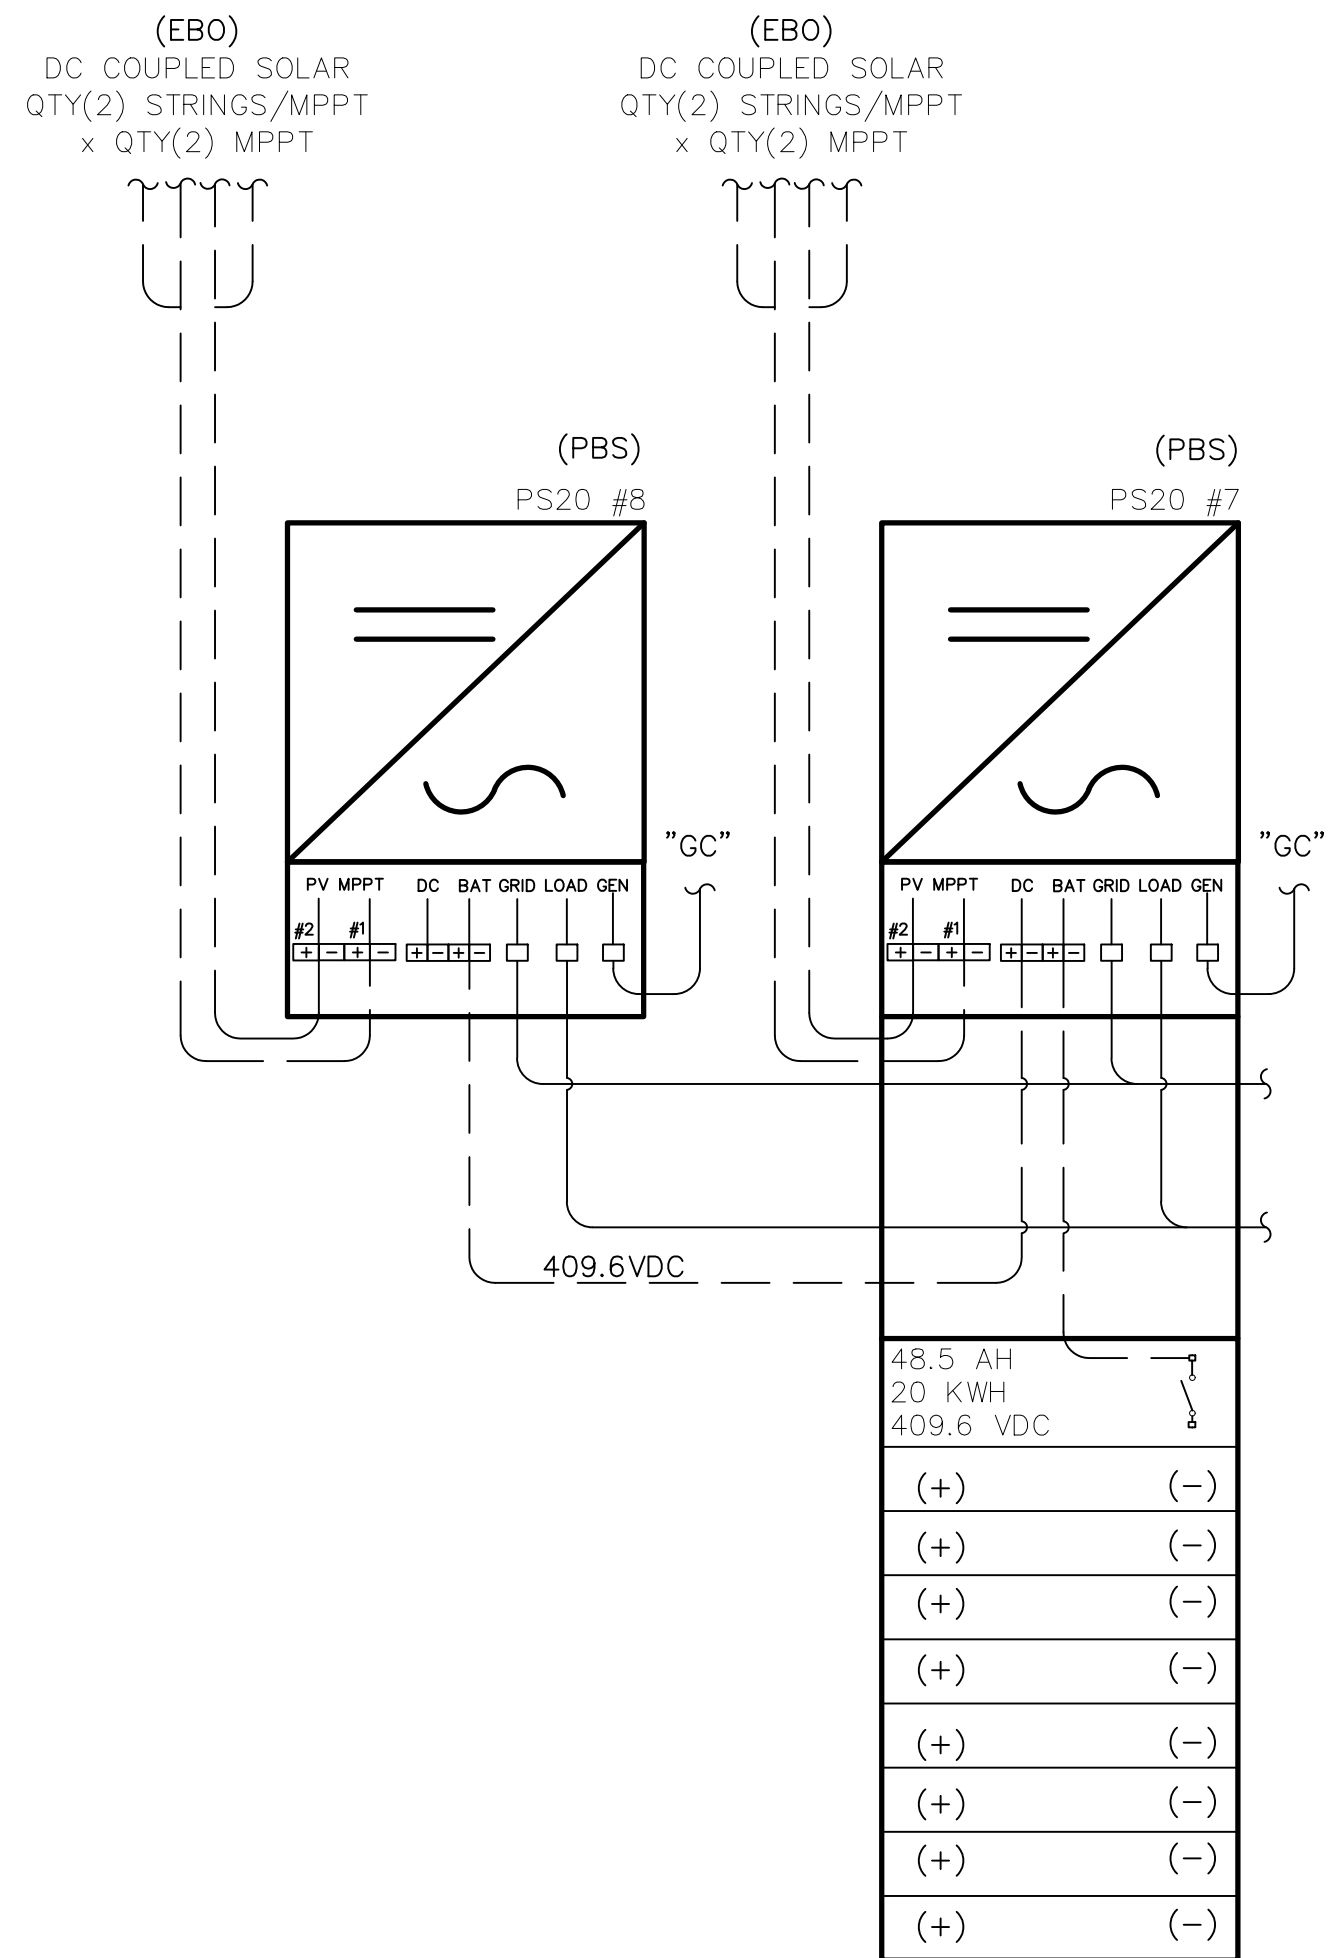

INTER-DISCIPLINE REVIEW						
DISC	ARCH	CIVIL	ELECT	I&C	MECH	STRUCT
DATE	*	*	*	*	*	*
INIT	*	*	*	*	*	*

00	VERSION 00	12-10-2025	MAW					
REV	REVISIONS		DATE	DRN	DSGN	CKD	APPD	

DSGN		
DRN	MAW	12-10-2025
CKD	JP	
SCALE: AS NOTED		

CERTIFICATE OF REGISTRATION NO. X-0000

SAVANT POWER		JOB NUMBER	REV
RESIDENTIAL MICROGRID		-	00
800A: 50KW - 80KWH ESS PS20 ONLINE DIAGRAM (120/240V)		DRAWING NUMBER 009-2562-00	