

SAVANT POWER STORAGE 20

PS20-12.5KW-100A-XX

GENERAL NOTES

1. CONCEPT ONLY: NOT FOR CONSTRUCTION OR PERMIT SUBMITTAL.
2. AS A BASIS FOR THE MINIMUM INSTALLATION CRITERIA, ENGINEER OF RECORD (EOR) IS TO ENSURE THAT ALL WORK MUST BE PERFORMED IN ACCORDANCE WITH THE LATEST EDITIONS OF THE STATE BUILDING CODE, STATE ELECTRICAL CODE, NFPA, ANSI/NECA INSTALLATION STANDARDS AND OTHER APPLICABLE CODES, REGULATIONS AND LAWS OF LOCAL, STATE AND FEDERAL GOVERNMENT, OTHER AUTHORITIES HAVING JURISDICTION AND APPLICABLE BASE BUILDING STANDARDS AND SPECIFICATIONS.
3. THESE DRAWINGS ILLUSTRATE A CONCEPT SHOWING MAJOR EQUIPMENT AND INTERCONNECTIONS BUT ARE NOT TO BE CONSIDERED FABRICATION / SITE SPECIFIC DRAWINGS. CABLE SIZING, SHORT CIRCUIT, GROUNDING, OVERCURRENT PROTECTION AND DISCONNECTING MEANS TO BE DESIGNED BY EOR WITH PE STAMPED SITE SPECIFIC CONTRACT DRAWINGS.
4. EOR TO ENSURE FINAL SYSTEM DESIGN ADHERES TO ALL APPLICABLE ARTICLES OF NEC INCLUDING ARTICLES 110, 240, 250, 310, 480, 690, 702, 705, 706 AND 750.
5. EOR SHALL REVIEW AND PROVIDE CALCULATIONS FOR ALL DOWNSTREAM LOADS FED BY THE PS20 INVERTER. ENSURE THAT THE COMBINATION OF ALL CONTINUOUS BASE LOAD & INRUSH SURGES CAUSED BY LINEAR AND NON-LINEAR LOADS ARE BELOW THE OVERLOAD SET POINT LIMITS OF THE INVERTER. CURRENT MAGNITUDE AND DURATION SHALL BE FACTORED INTO THE OVERALL DESIGN OF THE SYSTEM TO AVOID ANY NUISANCE TRIPPING. MITIGATION TECHNIQUES SUCH AS THE ADDITION OF SOFT-STARTS ON INDUCTIVE LOADS; RELOCATION OF LOADS TO NON-BACKED UP PANELS; OR GENERAL SYSTEM UPSIZING SHALL BE CONSIDERED.
6. EOR SHALL REVIEW AND PROVIDE CALCULATIONS FOR ALL DOWNSTREAM LOADS FED BY A GENERATOR WHEN CONNECTING TO THE PS20 SYSTEM IN AN OFF-GRID SITUATION. SIZE THE GENERATOR ACCORDING TO THE LATEST "SAVANT POWER STORAGE GENERATOR INSTALLATION AND ATS INTEGRATION GUIDE" FOUND IN THE "SAVANT POWER RESOURCE LINK" ON THIS SHEET.
7. FOR ALL PARALLEL INSTALLS, WHEN INSTALLING AC WIRE BETWEEN THE UPSTREAM BREAKERS IN THE GRID COMBINER PANEL (GCP) TO THEIR RESPECTIVE INVERTER GRID TERMINAL ON THE PS20, IT IS REQUIRED THAT THE WIRE LENGTH TO THE CLOSEST PS20 IS AT LEAST 65% THE WIRE LENGTH OF THE FURTHEST INSTALLED PS20 FROM THE GCP. THIS HELPS ENSURE THAT THE WIRE RESISTANCE DIFFERENCE IS KEPT TO A MINIMUM BETWEEN THE FURTHEST AND CLOSEST PS20. THE SAME IS REQUIRED FOR GENERATOR / AC COUPLED SOLAR APPLICATIONS USING A GENERATOR COMBINER PANEL FEEDING THE GEN TERMINALS ON PARALLEL PS20 UNITS.
8. DC SOLAR SHALL BE SUPPORTED IN UNLIMITED SOLAR SELL BACK; LIMITED SOLAR SELL BACK; AND NO SOLAR SELL BACK INTERCONNECTION AGREEMENTS.
9. AC SOLAR SHALL ONLY BE SUPPORTED IN UNLIMITED SOLAR SELL BACK INTERCONNECTION AGREEMENTS. IN OFF GRID SITUATIONS, FREQUENCY SHIFTING IS USED TO SHUT OFF AC SOLAR AT THE PS20 INVERTER GEN TERMINAL.
10. REFER TO POWER STORAGE 20 SPECIFICATIONS FOR ADDITIONAL INFORMATION.
11. REFER TO THE SAVANT POWER STORAGE 20 INSTALLATION GUIDE FOR ADDITIONAL INFORMATION SUCH AS MAINTENANCE SPACE REQUIREMENTS TO AID IN THE DESIGN OF YOUR PROJECT.

SAVANT POWER RESOURCE LINK

PLEASE USE THIS QR CODE TO GET TO ALL THE LATEST SPECIFICATION SHEETS, INSTALLATION GUIDES FOR THE SAVANT POWER SYSTEM.




PS20_GEN TO GRID_12_10_2025_V00_R00.DWG

INTER-DISCIPLINE REVIEW								DSGN	MAW	12-10-2025	SAVANT POWER	JOB NUMBER	REV
DISC	ARCH	CIVIL	ELECT	I&C	MECH	STRUCT	DRN	JP	AS NOTED	RESIDENTIAL MICROGRID		DRAWING NUMBER 009-2601-00	
DATE	*	*	*	*	*	*	00	VERSION 00	12-10-2025				MAW
INIT	*	*	*	*	*	*	REV	REVISIONS	DATE				DRN
CERTIFICATE OF REGISTRATION NO. X-0000											PS20 GENERAL NOTES GENERATOR TO GRID TERMINAL DESIGN		

- 200KWH RATED ENERGY STORAGE
- OFFGRID CONTINUOUS: 125KW / 520.83A
- QTY (20) 8.5KW / 26A RATED PEAK DC COUPLED PV MPPT CHANNELS. 6.25KW MAX PV/MPPT POWER PER CHANNEL.
- QTY (10) 12.5KW AC COUPLED PV INPUTS AT GEN TERMINAL
- MAXIMUM AC+DC COUPLED SOLAR COMBINATION: 12.5KW / BATTERY STACK
- 240KW / 1000A GRID PASS THROUGH
- CHARGE RATE: 6.5KW / INVERTER
- DISCHARGE RATE: 12.5KW / INVERTER

LEGEND & ABBREVIATIONS		KEYNOTE DRAWING NOTES	
(PBS)	PROVIDED BY SAVANT POWER, INSTALLED BY OTHERS	①	"GENERATOR TO GRID" SYSTEMS REQUIRE A SAVANT CONTROLLER (DIRECTOR OR PRO HOST). THE GPIO PORT ON THE CONTROLLER SHALL BE CONNECTED TO THE AUXILIARY POSITIONAL CONTACTS ON THE GENERATOR ATS. THIS TELLS THE SAVANT SYSTEM THE POSITIONAL STATUS OF THE GEN ATS (NORMAL VS EMERGENCY).
(EBO)	EQUIPMENT FURNISHED AND INSTALLED BY OTHERS	②	QTY (1) PS20 GRID TERMINAL INPUT IS RATED UP TO 24KW PER INVERTER FOR UTILITY OR GENERATOR PASS-THROUGH. GENERATOR POWER SHALL NOT BE LESS THAN THE POWER OF THE POTENTIAL HOUSE LOAD, PLUS THE SUM OF THE CHARGING POWER FOR ALL BATTERY STACKS.
(XM)	EQUIPMENT EXISTING TO REMAIN	③	CONSIDER USING A POLARIS TAP WITHIN THE ATS/MTS TO TAP THE INCOMING FEED. IF NO SPACE WITHIN THE ATS/MTS IS AVAILABLE, AN EXTERNAL JUNCTION BOX MAY BE USED.
SPD	SURGE PROTECTION DEVICE		
TYP	TYPICAL THROUGHOUT DRAWING		
AF	SWITCH DISCONNECT FUSE RATING		

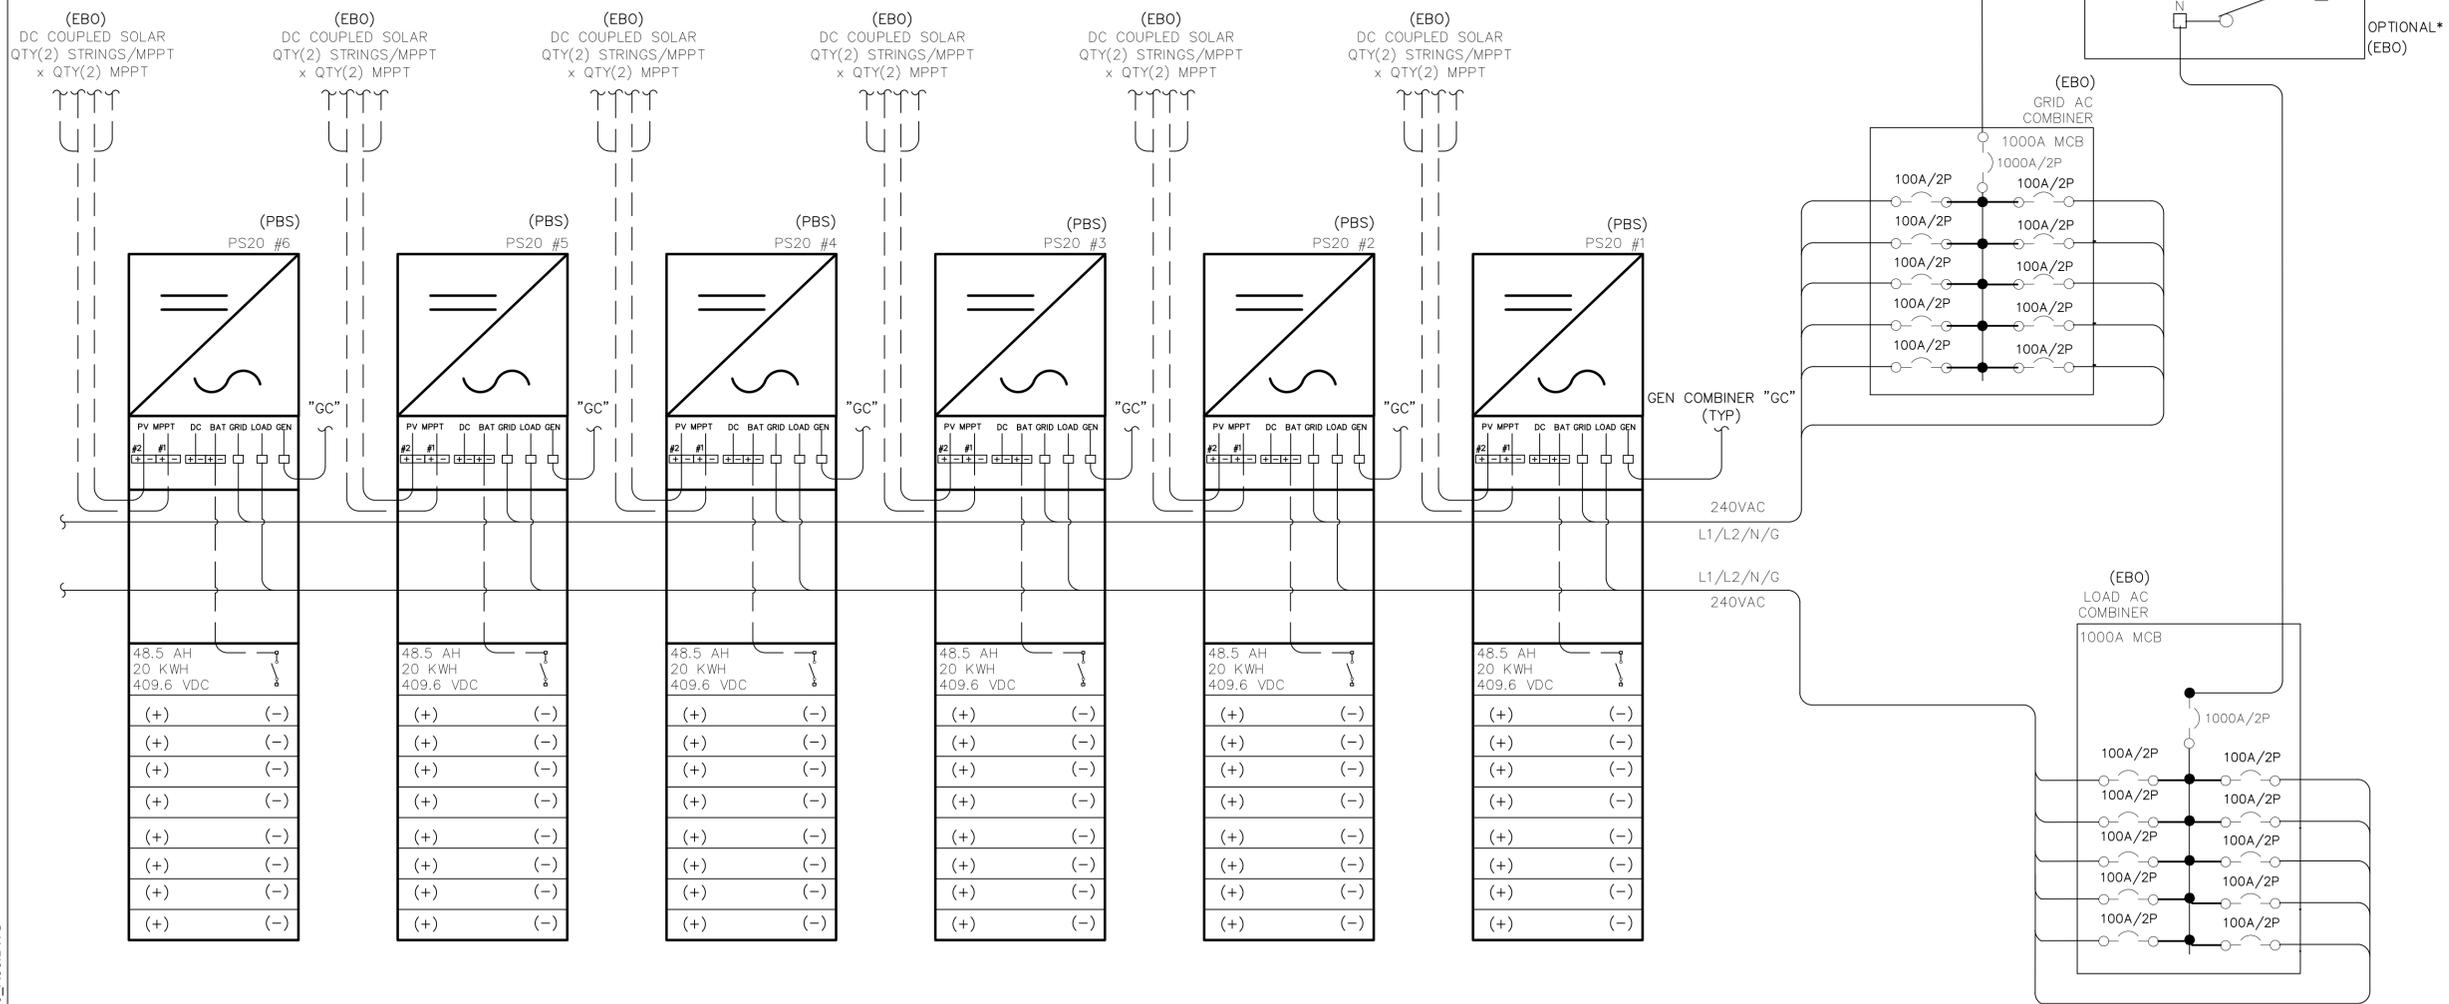

PS20_GEN TO GRID_12_10_2025_V00_R00.DWG

INTER-DISCIPLINE REVIEW								SAVANT POWER				JOB NUMBER	REV
DISC	ARCH	CIVIL	ELECT	I&C	MECH	STRUCT		DRN	MAW	12-10-2025			
DATE	*	*	*	*	*	*		CKD	JP				
INIT	*	*	*	*	*	*		SCALE: AS NOTED					
REV	00	VERSION 00		12-10-2025	MAW								DRAWING NUMBER
		REVISIONS		DATE	DRN	DSGN	CKD	APPD					009-2565-00


CERTIFICATE OF REGISTRATION NO. X-0000

1000A: 125KW - 200KWH ESS
PS20 ONLINE DIAGRAM (120/240V)

1000A POWER STORAGE 20 SYSTEM NOTES

- 200KWH RATED ENERGY STORAGE
- OFFGRID CONTINUOUS: 125KW / 520.83A
- QTY (20) 8.5KW / 26A RATED PEAK DC COUPLED PV MPPT CHANNELS. 6.25KW MAX PV/MPPT POWER PER CHANNEL.
- QTY (10) 12.5KW AC COUPLED PV INPUTS AT GEN TERMINAL
- MAXIMUM AC+DC COUPLED SOLAR COMBINATION: 12.5KW / BATTERY STACK
- 240KW / 1000A GRID PASS THROUGH
- CHARGE RATE: 6.5KW / INVERTER
- DISCHARGE RATE: 12.5KW / INVERTER

LEGEND & ABBREVIATIONS		KEYNOTE DRAWING NOTES	
(PBS)	PROVIDED BY SAVANT POWER, INSTALLED BY OTHERS	①	OCPD SIZING ON THIS CONCEPT DRAWING SHOWS THE MAXIMUM ALLOWABLE SIZE FOR THIS PS20 CONFIGURATION. ENGINEER OF RECORD TO SIZE OCPD AND CABLE SIZES ACCORDING TO SITE CONDITIONS AND LATEST NEC CODE. SEE GENERAL NOTES SHEET FOR ADDITIONAL DESIGN GUIDANCE.
(EBO)	EQUIPMENT FURNISHED AND INSTALLED BY OTHERS		
(XM)	EQUIPMENT EXISTING TO REMAIN	②	QTY (1) PS20 GEN TERMINAL INPUT IS RATED UP TO 12.5KW AC SOLAR PER BATTERY STACK. OFF GRID FREQUENCY SHIFTING IS AN INCLUDED FUNCTION ON THE GEN TERMINAL TO TURN AC SOLAR FEEDS ON OR OFF.
SPD	SURGE PROTECTION DEVICE		
TYP	TYPICAL THROUGHOUT DRAWING		
AF	SWITCH DISCONNECT FUSE RATING		

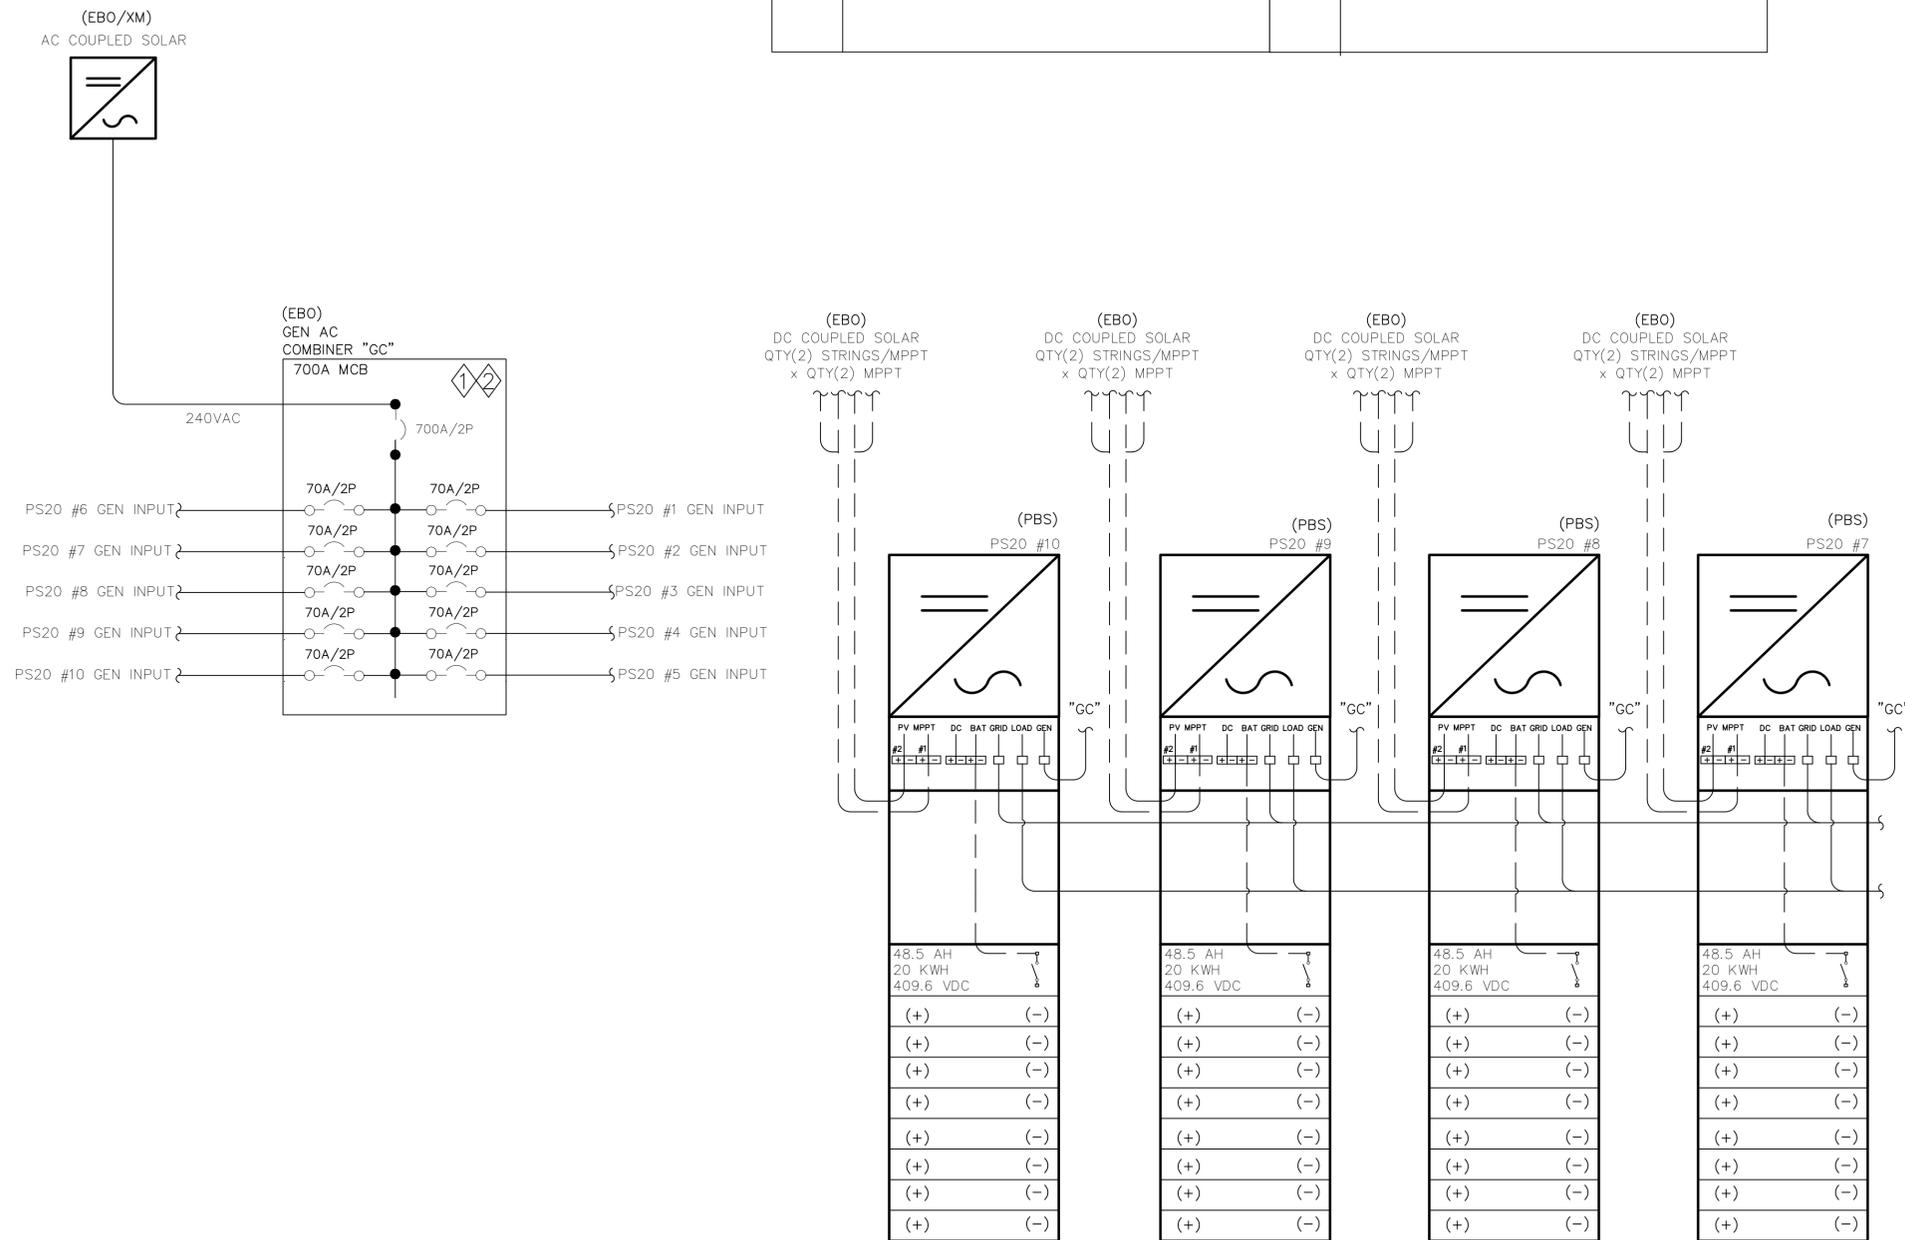

PS20_GEN TO GRID_12_10_2025_V00_R00.DWG

INTER-DISCIPLINE REVIEW											DSGN			SAVANT POWER		JOB NUMBER	REV	
DISC	ARCH	CIVIL	ELECT	I&C	MECH	STRUCT						DRN	MAW	12-10-2025	RESIDENTIAL MICROGRID		-	00
DATE	*	*	*	*	*	*						CKD	JP		DRAWING NUMBER			
INIT	*	*	*	*	*	*	00	VERSION 00	12-10-2025	MAW		SCALE: AS NOTED			1000A: 125KW - 200KWH ESS PS20 ONELINE DIAGRAM (120/240V)		009-2566-00	
REV	REVISIONS						DATE	DRN	DSGN	CKD	APPD	CERTIFICATE OF REGISTRATION NO. X-0000						